


Watchguard Generator Service

Level

7

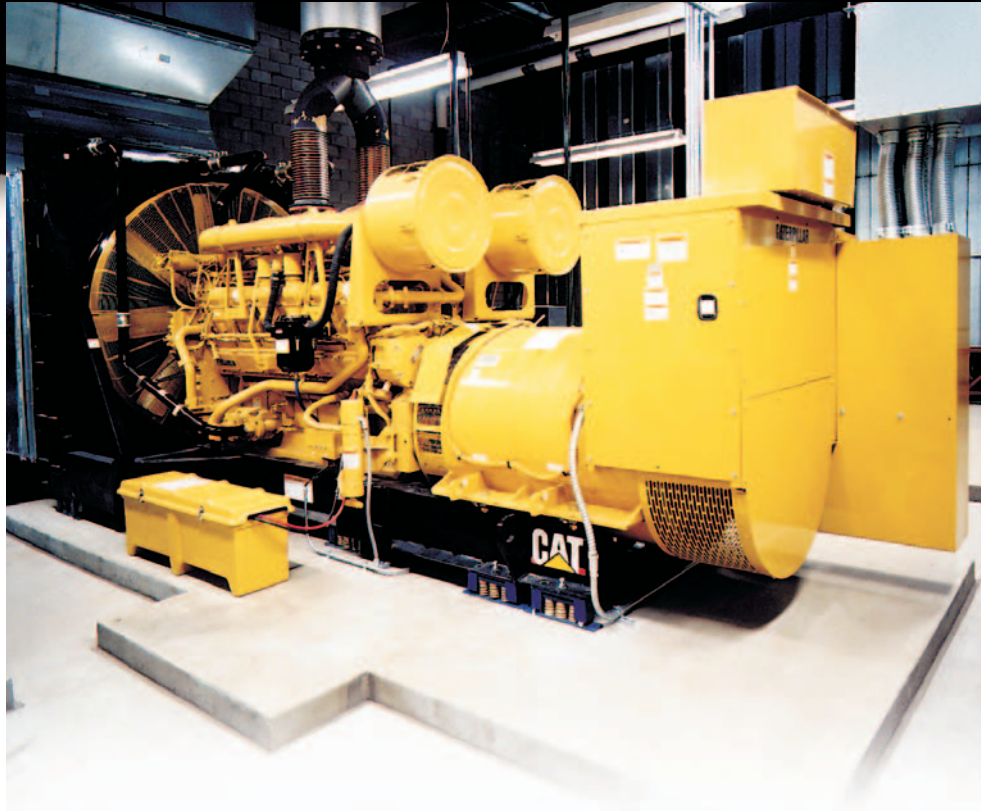

Level 7: Protective Relay Testing.

- Inspect cover gasket, glass, clearance between poles and disk, check for moisture
 - Clean and remove foreign materials as necessary
 - Clean pitted or burned contacts
 - Inspect relays - adjust, test and calibrate as required
 - Test relays for pick-up timing, contact action, restraint and any other pertinent characteristics necessary to ensure proper calibration and operation
- Recommended every 12 to 60 months, depending on application and utility requirements



Watchguard Service is a Ziegler preventive maintenance and inspection program, custom designed to help reduce generator operating costs, prolong component life and increase the overall reliability of your equipment.

ZIEGLER **CAT**
Power Systems

8050 COUNTY RD. 101 E.
SHAKOPEE, MN 55379
952.445.4292
888.320.4292

1500 ZIEGLER DR. N.W.
ALTOONA, IA 50009
515.957.3800
800.342.7002